

Trusted. Tested. Tough.®



SECTION: Z5.10.100
 ZM3382
 0126
 Supersedes
 1025

MAIL TO: P.O. BOX 16347 • Louisville, KY 40256-0347
 SHIP TO: 3649 Cane Run Road • Louisville, KY 40211-1961
 Tel: (502) 778-2731 • 1 (800) 928-PUMP

Visit our website:
 zoellerengineered.com

Product information presented here reflects conditions at time of publication. Consult factory regarding discrepancies or inconsistencies.

X6160 HAZARDOUS LOCATION SERIES TECHNICAL DATA

Class I, Division 1, Groups C & D Rated and Class I, Zone 1, Groups IIA & IIB Gas Areas

or
 Class II, Division 1, Groups E, F & G and Zone 20 Dust Areas
 Commercial Duty Effluent



	<input type="checkbox"/> X6161	<input type="checkbox"/> X6163
PUMP NAME PLATE HORSEPOWER:	1/2 HP	1/2 HP
SOLID SIZE: in (mm)	3/4" (19mm)	3/4" (19mm)
MINIMUM HEAD: ft. (m)	5.0' (1.5m)	5.0' (1.5m)
MAXIMUM HEAD: ft. (m)	56' (17.1m)	66' (20.1m)
MAX.FLOW GPM (L/min) @ MIN. HEAD ft. (m)	100 GPM @ 5' (379 L/min @ 1.5m)	61 GPM @ 5' (231 L/min @ 1.5m)
DISCHARGE SIZE: VERTICAL FEMALE	<input type="checkbox"/> 1-1/2" NPT; Optional Flange, order: <input type="checkbox"/> 2" NPT (10-1305) or <input type="checkbox"/> 3" NPT (10-1306)	

PUMP NET WEIGHT: lbs (kg)	125-133 (57-60 kg)	MOTOR TYPE CSA APPROVED:	SUBMERSIBLE Class 1 Gas Area Certified Class 2 Dust Area Certified
SERVICE FACTOR:	1.0		
MOTOR DESIGN LETTER:	NEMA B	TYPE SOW POWER CORD LENGTH: ft (m)	25' (7.62m) <input type="checkbox"/> Optional 50'
IMPELLER TYPE:	CAST IRON VORTEX	MOTOR SHAFT:	416 S.S.
SQUARE RINGS:	VITON	STATOR INSULATION:	CLASS B
RPM:	3450	STATOR AND LEAD WIRES INSULATION:	CLASS B
SURFACE TEMPERATURE CODE:	T5 (1PH) T6 (3PH)	MAXIMUM STATOR TEMPERATURE:	CLASS B 266 °F (130 °C)

SHAFT SEAL CONSTRUCTION:	STANDARD	CARBON/CERAMIC - UPPER CARBON/SILICON CARBIDE - LOWER
	OPTIONAL UPPER	<input type="checkbox"/> SILICON CARBIDE/SILICON CARBIDE
	OPTIONAL LOWER	<input type="checkbox"/> SILICON CARBIDE/SILICON CARBIDE
STANDARD SENSING DEVICES*	MOTOR THERMAL SHUTOFF	INTEGRAL OVERLOAD WITH AUTOMATIC RESET - 1 PHASE
	MOISTURE DETECTION	MOISTURE SENSING PROBES WITH LEAD WIRES
MINIMUM FLUID LEVEL FOR CONTINUOUS OPERATIONS: in (m)		24" (0.6 m)
MAXIMUM WATER TEMPERATURE:		104 °F (40 °C)
FLOAT MATERIAL FOR AUTOMATIC MODELS:		COPPER

*Requires a circuit in control panel to function.


ELECTRICAL DATA

MODEL	HP	<input type="checkbox"/> 115V/1Ph		<input type="checkbox"/> 575V/3Ph	
		FLA	LRA	FLA	LRA
<input type="checkbox"/> X6161	1/2	15.5	31.2	2.4	11.3
<input type="checkbox"/> X6163	1/2	15.0	31.2	2.4	11.3

Refer to reverse side for Head/Capacity Performance Curves

© Copyright 2026 Zoeller® Co. All rights reserved.

**TOTAL DYNAMIC HEAD/FLOW
PER MINUTE
EFFLUENT AND DEWATERING**

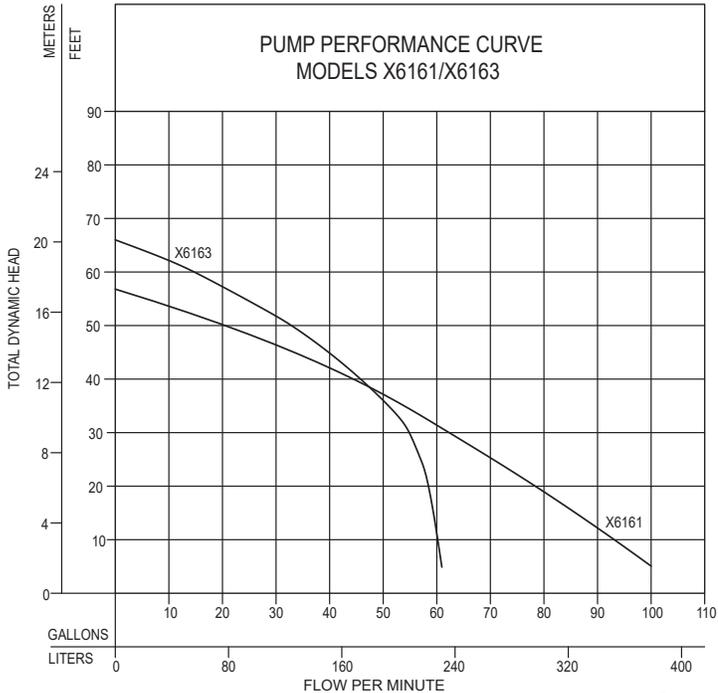

MODELS		X6161		X6163	
Feet	Meters	Gal.	Liters	Gal.	Liters
5	1.5	100	379	61	231
10	3.0	93	352	60	227
15	4.6	86	326	60	227
20	6.1	79	299	59	223
25	7.6	71	267	57	216
30	9.1	62	235	55	208
40	12.2	45	170	46	174
50	15.2	20	76	33	125
60	18.3	--	--	15	57
70	21.3	--	--	--	--
80	24.4	--	--	--	--
Shut-off Head:		56 ft. (17.1m)		66 ft. (20.1m)	



009920

Automatic

Nonautomatic

Standard all models - 25 ft. cord - 1/2 H.P.				
X6161 MODELS	Control Selection			Listings
	Volts	Ph	Amps	cCSAus
MX6161	115	1	15.5	Yes
NX6161	115	1	15.5	Yes
BAX6161	575	3	2.4	Yes

Standard all models - 25 ft. cord - 1/2 H.P.				
X6163 MODELS	Control Selection			Listings
	Volts	Ph	Amps	cCSAus
MX6163	115	1	15.0	Yes
NX6163	115	1	15.0	Yes
BAX6163	575	3	2.4	Yes

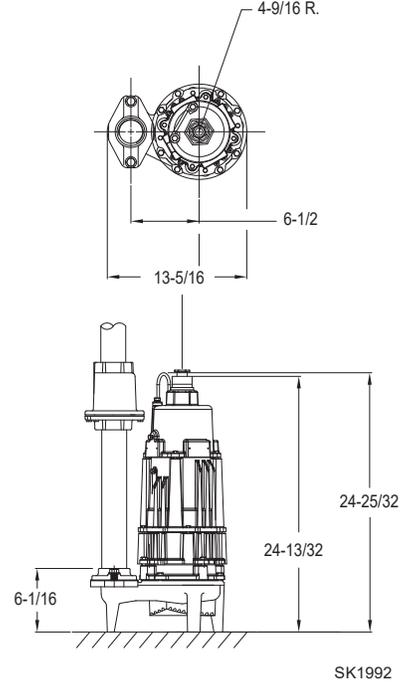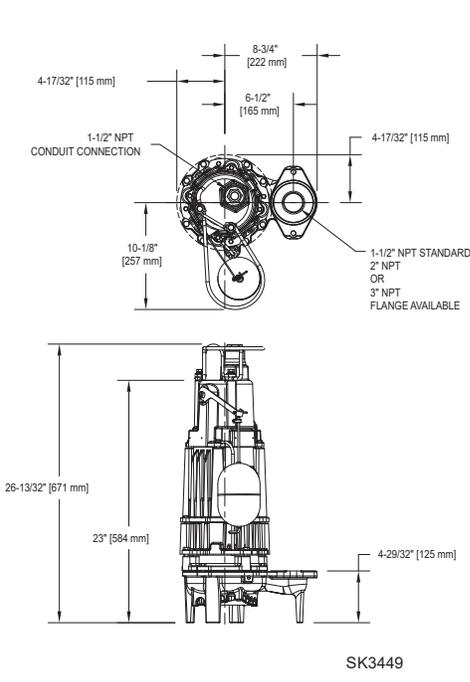

SK3449

SK1992

FEATURES

- Durable epoxy coated cast iron construction
- Motor - 1/2 HP or 1 HP, 60 Hz, 3450 RPM, 1 PH, oil filled, hermetically sealed.
- Thermal sensor with lead wire (3PH), integral overload with automatic reset (1 PH)
- Bearings - upper and lower ball bearings
- Stainless steel motor shaft
- Impeller - non-clogging cast iron vortex design passes 3/4" spherical solids
- No screens to clog
- Stainless steel screws, bolts and handle
- Corrosion resistant powder coated epoxy finish
- Moisture sensors for early warning of seal failure.
- 100% computerized tested

CAUTION All installation of controls, protection devices and wiring should be done by a qualified licensed electrician. All electrical and safety codes should be followed including the most recent National Electrical Code (NEC) and the Occupational Safety and Health Act (OSHA).